


Parkunit	Total Hours	Active Prod. Total kWh	Active Consumption kWh	Active Prod. Generator 1 kWh	Active Prod. Generator 2 kWh	Reactive Prod. Total kVArh	Capacity Factor %
<i>WTG01 (99.9%)</i>	<i>671.8</i>	<i>1,046,621.5</i>	<i>-3,100.7</i>	<i>1,049,722.2</i>	<i>0.0</i>	<i>-147.5</i>	<i>47.17</i>
WTG02	672.0	1,049,355.8	-3,007.4	1,052,363.2	0.0	-48.9	47.32
<i>WTG03 (99.9%)</i>	<i>671.7</i>	<i>1,043,712.6</i>	<i>-3,277.9</i>	<i>1,046,990.5</i>	<i>0.0</i>	<i>-85.9</i>	<i>47.06</i>
WTG04	672.0	1,063,700.8	-3,153.2	1,066,854.0	0.0	-98.1	47.97
<i>WTG05 (99.9%)</i>	<i>671.7</i>	<i>995,183.8</i>	<i>-3,349.2</i>	<i>998,533.0</i>	<i>0.0</i>	<i>-638.1</i>	<i>44.87</i>
WTG06	672.0	1,024,125.0	-3,112.0	1,027,237.0	0.0	143.9	46.18
Total	4,031.2	6,222,699.5	-19,000.4	6,241,699.9	0.0	-874.6	
Min	671.7	995,183.8	-3,349.2	998,533.0	0.0	-638.1	44.87
Avg	671.9	1,037,116.6	-3,166.7	1,040,283.3	0.0	-145.8	46.76
Max	672.0	1,063,700.8	-3,007.4	1,066,854.0	0.0	143.9	47.97
Std.Dev	0.2	24,155.8	125.4	24,080.3	0.0	261.4	

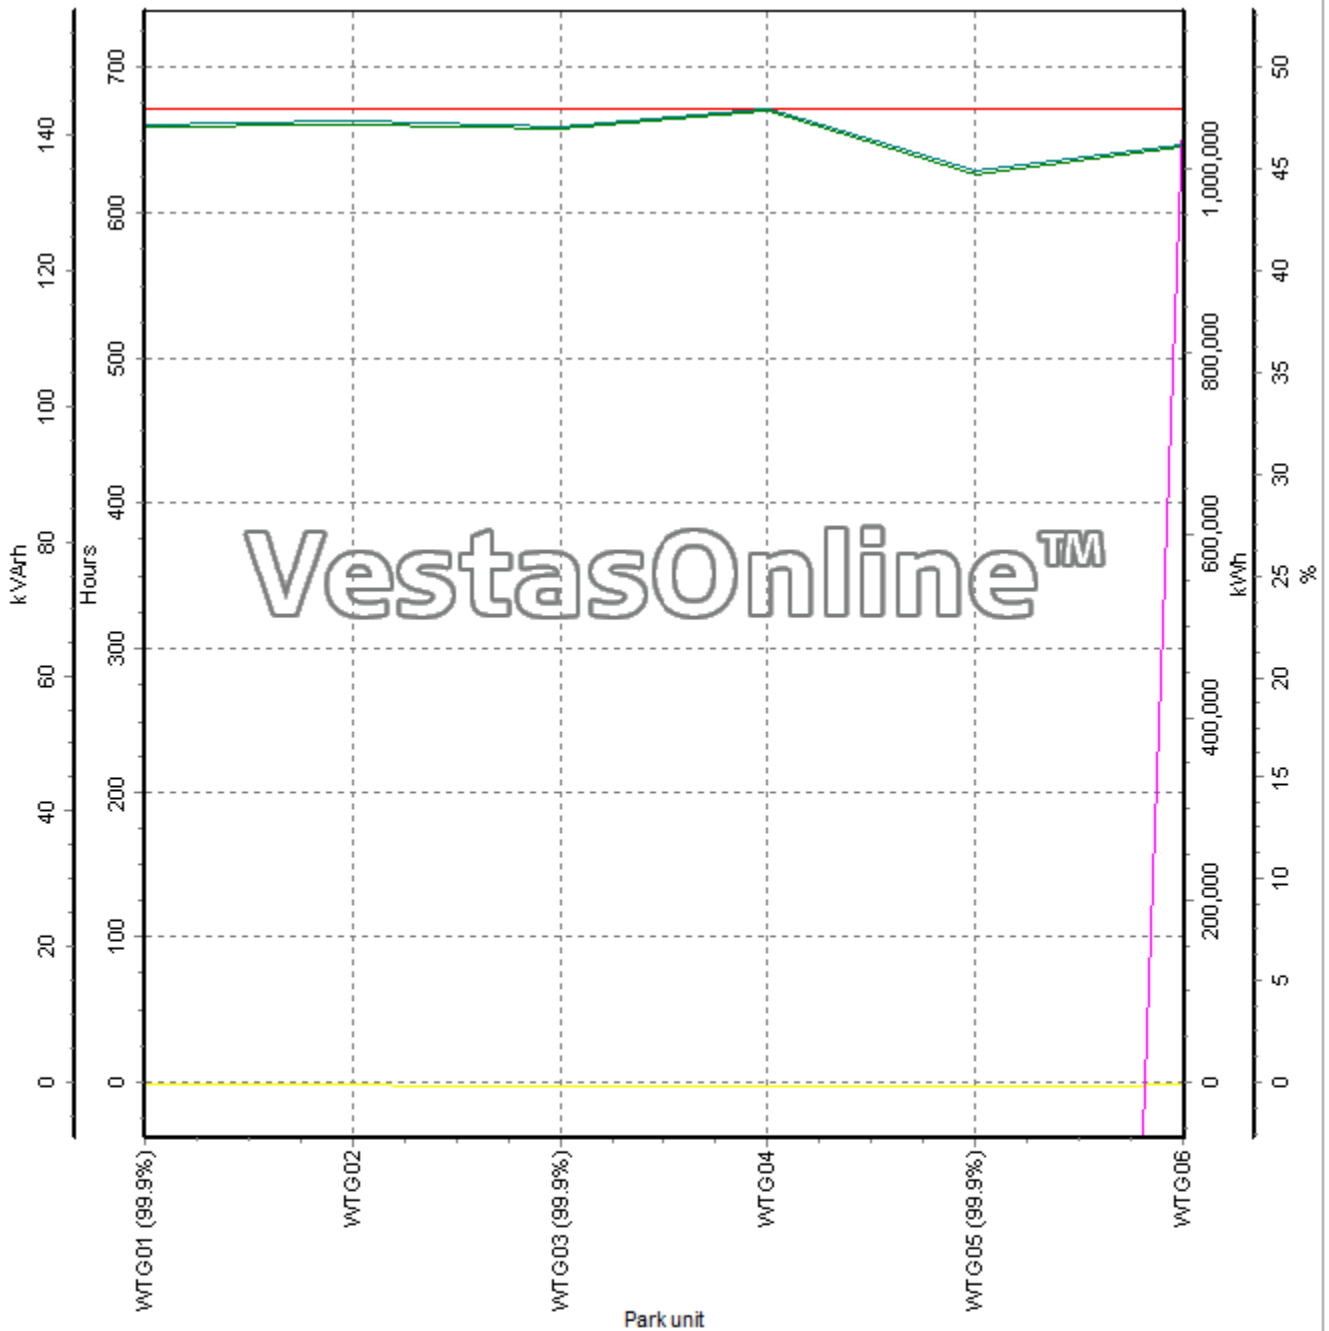

<input checked="" type="checkbox"/>	— Total (null) (Hours)	<input checked="" type="checkbox"/>	— Active Prod. Total (kWh)
<input checked="" type="checkbox"/>	— Active Consumption (kWh)	<input checked="" type="checkbox"/>	— Active Prod. Generator 1 (kWh)
<input type="checkbox"/>	— Active Prod. Generator 2 (kWh)	<input checked="" type="checkbox"/>	— Reactive Prod. Total (kVArh)
<input checked="" type="checkbox"/>	— Capacity Factor (%)		